

HW Series Emergency Stop Switches

Emergency Stop Switches (with Removable Contact Block) Specifications

- Direct opening action mechanism.
IEC60947-5-5, 5.2, IEC60947-5-1, Annex K
- Safety lock mechanism(IEC60947-5-5, 6.2)
- Degree of protection: IP65 (IEC60529)



Contact Ratings

Contact Block	Rated Insulation Voltage	600V
	Rated Thermal Current	10A
	Contact Ratings by Utilization Category IEC60947-5-1	AC-15 (A600) DC-13




Operating Voltage and Current by Utilization Category

Operating Voltage			24V	48V	50V	110V	220V	440V
Operating Current	AC 50/60 Hz	AC-12 Control of resistive loads and solid state loads	10A	–	10A	10A	6A	2A
		AC-15 Control of electromagnetic loads (> 72 VA)	10A	–	7A	5A	3A	1A
	DC	DC-12 Control of resistive loads and solid state loads	10A	5A	–	2.2A	1.1A	–
		DC-13 Control of electromagnets	5A	2A	–	1.1A	0.6A	–

Specifications


Operating Temperature	–25 to +60°C (no freezing)
Storage Temperature	–40 to +80°C (no freezing)
Operating Humidity	45 to 85% RH (no condensation)
Minimum Force Required for Direct Opening Action	50N
Minimum Operator Stroke Required for Direct Opening Action	5.5 mm
Maximum Operator Stroke	10 mm
Contact Resistance	50 mΩ maximum (initial value)
Insulation Resistance	100 MΩ minimum (500V DC megger)
Dielectric Strength	Between live and dead metal parts Between terminals of different poles Between terminals of the same pole 2,500V AC, 1 minute
Shock Resistance	Operating extremes: 100 m/s ² Damage limits: 1,000 m/s ²
Vibration Resistance	Operating extremes: 5 to 55Hz, amplitude 0.5 mm Damage limits: 30 Hz, amplitude 1.5 mm
Operating Frequency	900 operations/h
Life	Mechanical: 500,000 operations minimum (push-pull: 250,000 operations)
	Electrical: 500,000 operations minimum (push-pull: 250,000 operations) (at 900 operations/h, duty ratio 40%)
Protection	IP65 (IEC 60529)
Short-circuit protection	250V/10A fuse (Type aM IEC60269-1/IEC60269-2)
Terminal Style	M3.5 screw
Weight (approx.)	76g (HW1B-V322) 99g (HW1B-X422R) 54g (HW1B-Y202) 79g (HW1B-V422R-EMO)

Pushlock Turn Reset Switches

Shape	Contact	Part No.	Button Color
ø29mm Mushroom Pushlock Turn Reset HW1B-V3 	1NC	HW1B-V301①	Specify a button color code in place of ① in the Part No. R: red Y: yellow
	1NO-1NC	HW1B-V311①	
	2NC	HW1B-V302①	
	2NO-2NC	HW1B-V322①	
ø40mm Mushroom Pushlock Turn Reset HW1B-V4 	1NC	HW1B-V401①	
	1NO-1NC	HW1B-V411①	
	2NC	HW1B-V402①	
	2NO-2NC	HW1B-V422①	
ø60mm Mushroom Pushlock Turn Reset HW1B-V5 	1NC	HW1B-V501①	
	1NO-1NC	HW1B-V511①	
	2NC	HW1B-V502①	
	2NO-2NC	HW1B-V522①	


- Yellow buttons cannot be used as emergency stop switches in compliance with EN standards.
- For pushlock turn reset, when pressed, the button is held depressed. The button is released by turning clockwise.
- Pushlock turn reset switches with one or three contact blocks contain a dummy block.
- Safety lever lock HW9Z-LS is supplied with the switch.
- Other contact arrangements and gold-plated silver contacts are also available. See page 2.

Pushlock Key Reset Switches

Shape	Contact	Part No.	Button Color
 ø40mm Mushroom Pushlock Key Reset HW1B-X4	1NC	HW1B-X401R	Red only
	1NO-1NC	HW1B-X411R	
	2NC	HW1B-X402R	
	2NO-2NC	HW1B-X422R	



- For pushlock key reset switches, when pressed, the button is held depressed. The button is released by turning the key clockwise.
- Pushlock key reset switches with one or three contact blocks contain a dummy block.
- Two identical keys are supplied. (HW9Z-SK-231)
- Lever stopper is supplied. (HW9Z-LS)
- Other contact arrangements and gold-plated silver contacts are also available. See Part No. Development.

Push-Pull Switches

Shape	Contact	Part No.	Button Color
 ø40mm Mushroom Push-Pull (2-position) HW1B-Y2	1NC	HW1B-Y201①	Specify a button color code in place of ① in the Part No. R: red Y: yellow
	1NO-1NC	HW1B-Y211①	
	2NC	HW1B-Y202①	

- Yellow buttons cannot be used as emergency stop switches in compliance with EN standards.
- For push-pull switches, the button is maintained at either pulled or depressed position.
- Push-pull switches with one contact block contain a dummy block.
- Push-pull switches are available with one or two contact blocks.
- Lever stopper is supplied. (HW9Z-LS)


Nameplate (for ø22 Emergency Stop Switches)

Shape	Name	Part No.	Ordering No.	Remarks
	Blank	HWAV-0-Y	HWAV-0-Y	HWAV-27-Y Background: Yellow Legend: Black Applicable panel thickness: 0.8 to 4.5mm Material: Polyamide Plastic  (Note) Not applicable for ø60 mm mushroom buttons. Legend "EMERGENCY STOP" is indicated outside a ø44mm circle. (Panel cut-out: page 3)
	EMERGENCY STOP	HWAV-27-Y	HWAV-27-Y	

- EMERGENCY OFF and white nameplates (blank) also available. For SEMI Emergency Off (EMO) Switches and Stop Switches, see website.

Part No. Development

HW series Emergency Stop Switches (page 1, 2)

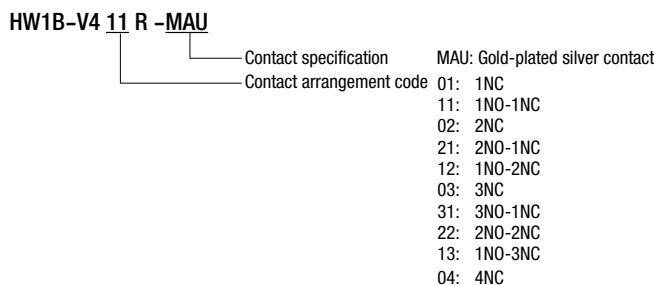


- Note
- Push-pull HW1B-Y2 can have a maximum of two contact blocks.
 - For emergency stop purposes, these switches must contain at least one NC contact block.


Dimensions

(All dimensions in mm)


ø29mm Pushlock Turn Reset
HW1B-V3

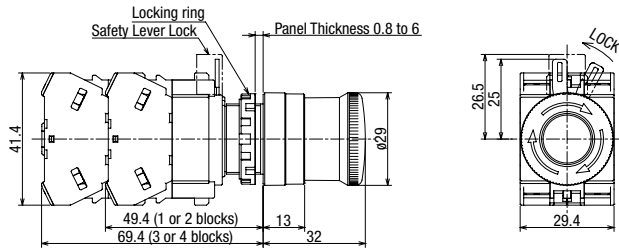


ø40mm Pushlock Turn Reset
HW1B-X4

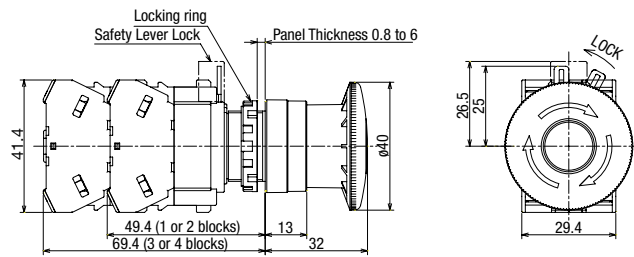


ø60mm Pushlock Turn Reset
HW1B-V5

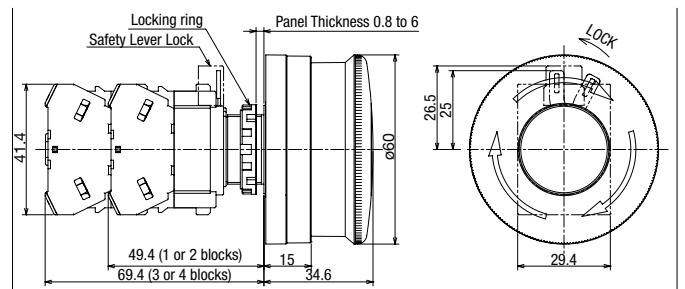


ø40mm Pushlock Turn Reset
HW1B-X4

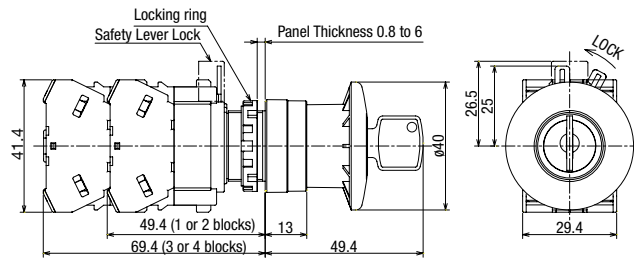

ø40mm Push-Pull
HW1B-Y2

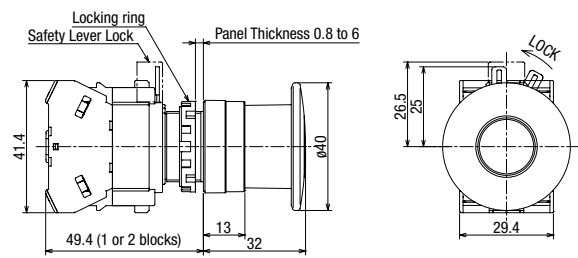


Bottom View

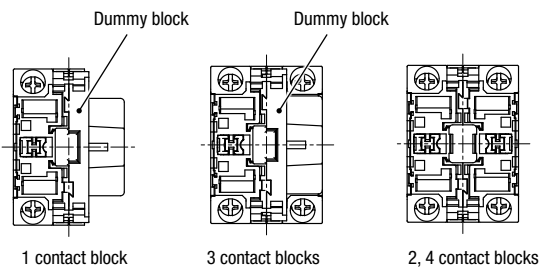

- For wiring, see ø22 HW series Switches & Pilot Lights catalog
- Integrated terminal cover

Panel Cut-Out / Mounting Hole Layout



HW1B (Minimum Mounting Centers for Emergency Stop Switches)

















	Vertical Spacing	Horizontal Spacing
HW1B-V3 HW1B-V4 HW1B-X4 HW1B-Y2	50mm minimum	50mm minimum
HW1B-V5	60mm minimum	60mm minimum

Note: When using the safety lever lock, determine the vertical spacing in consideration of convenience for installing and removing the safety lever lock.






Recommended vertical spacing: 100 mm

- The minimum mounting centers shown below are applicable to emergency stop switches with one layer of contact blocks (two contact blocks). When two layers of contact blocks are mounted, determine the minimum mounting centers in consideration of convenience for wiring. (see ø22 HW series Switches & Pilot Lights catalog)

Accessories

Shape	Material	Part No.	Ordering No.	Package Quantity	Remarks
	Metal (brass) (weight: approx. 150g)	MW9Z-T1	MW9Z-T1	1	Used to tighten the locking ring when installing the HW switch onto a panel. 
	Rubber (Black)	OR-55	OR-55	1	Used to install and remove the LED lamps. 
	<Ring> Polyamide <Gasket> Nitrile rubber	HW9Z-RL	HW9Z-RLPN10	10	IP65 protection 
	Rubber (Black) Nitrile	OB-31	OB-31PN05	5	<ul style="list-style-type: none"> Used to plug the unused $\varnothing 22.2$ mm mounting holes. Degree of protection: IP40 
	Polyamide	LW9Z-BP1	LW9Z-BP1	1	<ul style="list-style-type: none"> Used to plug the unused $\varnothing 22.2$mm mounting holes. Tightening torque: 2.0 N·m Degree of protection: IP65 Panel thickness: 0.8 to 6.0mm 
	<Plug> Metal (Diecast) <Locking ring> Polyamide <Gasket> Nitrile rubber	LW9Z-BM	LW9Z-BM	1	<ul style="list-style-type: none"> Used to plug the unused $\varnothing 22.2$ mm mounting holes. Tightening torque : 1.2N·m Degree of protection: IP66 (without $\varnothing 3.2$ anti-rotation ring) Panel thickness: 0.8 to 6.0mm 
	Polyamide	HW-VU1	HW-VU1PN10	10	<ul style="list-style-type: none"> Used to prevent contact between adjacent lead wires when units are mounted closely (Barriers should always be used in close mounting.) 
	Rubber	HW9Z-A25	HW9Z-A25PN05	5	<ul style="list-style-type: none"> Used to install the HW series units into $\varnothing 25$ mm mounting holes. IP65 Cannot be used with anti-rotation, nameplate Mounting panel thickness: 1.2 to 6.0 mm
	Body: Plastic Washer: Metal	HW9Z-A30	HW9Z-A30PN02	2	<ul style="list-style-type: none"> Used to install the HW series units (round type) into $\varnothing 30$ mm mounting holes (except for HW1E.) Degree of protection: IP65 Cannot be used with anti-rotation ring, nameplate fullshroud illuminated pushbuttons, pushbutton selectors, and mono-lever switches. Mounting panel thickness: 1.6 to 4.0 mm

Maintenance Parts

Shape	Material	Part No.	Ordering No.	Package Quantity	Remarks
	Polyacetal (yellow)	HW9Z-LS	HW9Z-LSPN10	10	A safety lever lock is supplied with a standard HW series
	Polyamide (black) ø28.4 H5 M22P1	HW9Z-LN	HW9Z-LNPN05	5	Black
	Nitryl rubber (black)	HW9Z-WM	HW9Z-WMPN10	10	Black 
	Metal (nickel-plated brass)	HW9Z-SK-231	HW9Z-SK-231PN02	2	For pushlock key reset switches


 Safety Precautions

- Turn off the power before starting installation, removal, wiring, maintenance, and starting installation, removing, wiring, maintenance, and inspection of the products. Failure to turn power off may cause electrical shocks or fire hazard.
- To avoid a burn on your hand, use the lamp holder tool when replacing lamps.
- For wiring, use wires of a proper size to meet the voltage and current requirements. Tighten the terminal screws to the recommended tightening torque (see page 6). Failure to tighten terminal screws may cause overheat and fire.

Operating Instructions

Panel Mounting


- 1) Remove the contact block from the operator.
- 2) Remove the locking ring from the operator.
- 3) Insert the operator into the panel cut-out from the front.
When installing the nameplate insert between the operator and panel.
- 4) Tighten the locking ring from the back to install the contact block to the operator.

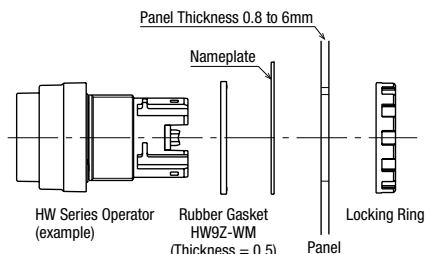


Mounting panel thickness is reduced by 1.5 mm when using a nameplate.

Removing the Contact Block

- 1) Remove the safety lever lock (yellow) from the lock lever by inserting a flat screwdriver into the safety lever lock and push upwards.

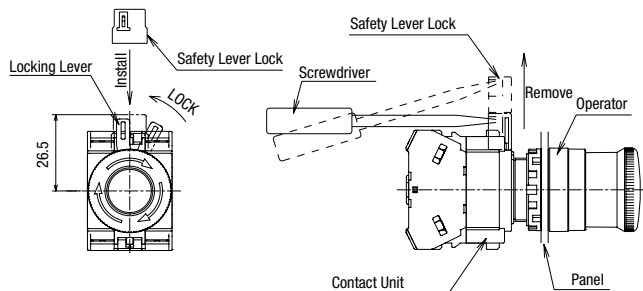

- 2) Remove the operator from the contact block by turning the locking lever in the direction of the arrow shown below. Then the operator can be pulled out.

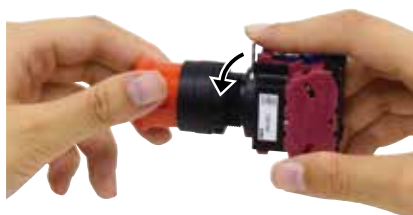

- 3) To reinstall, place the TOP marking on the operator and the lock lever in the same direction, and insert the operator into the contact block mounting adapter. Then turn the locking lever in the opposite direction.
- 4) Install the safety lever lock (yellow) on the lock lever. The safety lever lock cannot be installed when the lock lever is not upright.

Safety Lever Lock

IDEC strongly recommends using the safety lever lock (HW9Z-LS, yellow) to ensure that lock lever is locked, or to prevent maintenance personnel from unlocking contacts during wiring.

How to install

Mount the HW series onto the panel, lock the lever, and push in the safety lever lock.

Spacing in Vertical Direction

HW series can be installed with a minimum of 50 mm spacing in vertical direction. Be sure to take the space required for installing/removing the safety lever lock into consideration. When the spacing is narrower than the recommended value, install the HW series units in the order of low to high. When removing, do so in the opposite direction.

Notes for Panel Mounting

Locking ring wrench recommended torque

Tighten the bezel to a tightening torque of 2.0 N·m.

Locking ring wrench

Locking ring wrench (MW9Z-T1) can be used to tighten the bezel. Do not use pliers. Excessive tightening will damage the locking ring.




Panel Thickness

HW series can be mounted on a panel with thickness of 0.8 to 6.0 mm. Take the thickness of nameplate and/or switch guard into consideration.

Contact Blocks

Insert a flat screwdriver (4 to 6 mm) into the snap-fit latches of the contact block or full voltage adapter and lift to remove.



- Make sure to lift both latches. Contact blocks cannot be removed by lifting one latch only.
- Do not apply excessive force to the latches, otherwise damage may be caused.

Recommended Tightening Torque

Number of Wires

Unit	Wire	Number of Wires	Recommended Tightening Torque	Terminal Screw	
HW-U Contact Block	Crimping Terminal		2	1.0 to 1.3	M3.5
	Solid Wire	ø0.5 to 1.6 mm (AWG14 to 22)	2	1.0 to 1.3	
		ø1.7 to 2.0 mm (AWG12)	1	1.2 to 1.3	
	Stranded Wire	0.3 to 2.0 mm ² (AWG14 to 22)	2	1.0 to 1.3	
		2.1 to 3.5 mm ² (AWG12)	1	1.2 to 1.3	

Ordering Terms and Conditions

Thank you for using IDEC Products.

By purchasing products listed in our catalogs, datasheets, and the like (hereinafter referred to as "Catalogs") you agree to be bound by these terms and conditions. Please read and agree to the terms and conditions before placing your order.

1. Notes on contents of Catalogs

- (1) Rated values, performance values, and specification values of IDEC products listed in this Catalog are values acquired under respective conditions in independent testing, and do not guarantee values gained in combined conditions.
Also, durability varies depending on the usage environment and usage conditions.
- (2) Reference data and reference values listed in Catalogs are for reference purposes only, and do not guarantee that the product will always operate appropriately in that range.
- (3) The specifications / appearance and accessories of IDEC products listed in Catalogs are subject to change or termination of sales without notice, for improvement or other reasons.
- (4) The content of Catalogs is subject to change without notice.

2. Note on applications

- (1) If using IDEC products in combination with other products, confirm the applicable laws / regulations and standards.
Also, confirm that IDEC products are compatible with your systems, machines, devices, and the like by using under the actual conditions. IDEC shall bear no liability whatsoever regarding the compatibility with IDEC products.
- (2) The usage examples and application examples listed in Catalogs are for reference purposes only. Therefore, when introducing a product, confirm the performance and safety of the instruments, devices, and the like before use. Furthermore, regarding these examples, IDEC does not grant license to use IDEC products to you, and IDEC offers no warranties regarding the ownership of intellectual property rights or non-infringement upon the intellectual property rights of third parties.
- (3) When using IDEC products, be cautious when implementing the following.
 - i. Use of IDEC products with sufficient allowance for rating and performance
 - ii. Safety design, including redundant design and malfunction prevention design that prevents other danger and damage even in the event that an IDEC product fails
 - iii. Wiring and installation that ensures the IDEC product used in your system, machine, device, or the like can perform and function according to its specifications
- (4) Continuing to use an IDEC product even after the performance has deteriorated can result in abnormal heat, smoke, fires, and the like due to insulation deterioration or the like. Perform periodic maintenance for IDEC products and the systems, machines, devices, and the like in which they are used.
- (5) IDEC products are developed and manufactured as general-purpose products for general industrial products. They are not intended for use in the following applications, and in the event that you use an IDEC product for these applications, unless otherwise agreed upon between you and IDEC, IDEC shall provide no guarantees whatsoever regarding IDEC products.
 - i. Use in applications that require a high degree of safety, including nuclear power control equipment, transportation equipment (railroads / airplanes / ships / vehicles / vehicle instruments, etc.), equipment for use in outer space, elevating equipment, medical instruments, safety devices, or any other equipment, instruments, or the like that could endanger life or human health
 - ii. Use in applications that require a high degree of reliability, such as provision systems for gas / waterworks / electricity, etc., systems that operate continuously for 24 hours, and settlement systems
 - iii. Use in applications where the product may be handled or used deviating from the specifications or conditions / environment listed in the Catalogs, such as equipment used outdoors or applications in environments subject to chemical pollution or electromagnetic interference
If you would like to use IDEC products in the above applications, be sure to consult with an IDEC sales representative.

3. Inspections

We ask that you implement inspections for IDEC products you purchase without delay, as well as thoroughly keep in mind management/maintenance regarding handling of the product before and during the inspection.

4. Warranty

- (1) Warranty period
The warranty period for IDEC products shall be one (1) year after purchase or delivery to the specified location. However, this shall not apply in cases where there is a different specification in the Catalogs or there is another agreement in place between you and IDEC.
- (2) Warranty scope
Should a failure occur in an IDEC product during the above warranty period for reasons attributable to IDEC, then IDEC shall replace or repair that product, free of charge, at the purchase location / delivery location of the product, or an IDEC service base. However, failures caused by the following reasons shall be deemed outside the scope of this warranty.
 - i. The product was handled or used deviating from the conditions / environment listed in the Catalogs
 - ii. The failure was caused by reasons other than an IDEC product
 - iii. Modification or repair was performed by a party other than IDEC
 - iv. The failure was caused by a software program of a party other than IDEC
 - v. The product was used outside of its original purpose
 - vi. Replacement of maintenance parts, installation of accessories, or the like was not performed properly in accordance with the user's manual and Catalogs
 - vii. The failure could not have been predicted with the scientific and technical standards at the time when the product was shipped from IDEC
 - viii. The failure was due to other causes not attributable to IDEC (including cases of force majeure such as natural disasters and other disasters)Furthermore, the warranty described here refers to a warranty on the IDEC product as a unit, and damages induced by the failure of an IDEC product are excluded from this warranty.

5. Limitation of liability

The warranty listed in this Agreement is the full and complete warranty for IDEC products, and IDEC shall bear no liability whatsoever regarding special damages, indirect damages, incidental damages, or passive damages that occurred due to an IDEC product.

6. Service scope

The prices of IDEC products do not include the cost of services, such as dispatching technicians. Therefore, separate fees are required in the following cases.

- (1) Instructions for installation / adjustment and accompaniment at test operation (including creating application software and testing operation, etc.)
- (2) Maintenance inspections, adjustments, and repairs
- (3) Technical instructions and technical training
- (4) Product tests or inspections specified by you

The above content assumes transactions and usage within your region. Please consult with an IDEC sales representative regarding transactions and usage outside of your region. Also, IDEC provides no guarantees whatsoever regarding IDEC products sold outside your region.

IDEC CORPORATION

Head Office 6-64, Nishi-Miyahara-2-Chome, Yodogawa-ku, Osaka 532-0004, Japan

USA IDEC Corporation
EMEA APEM SAS

Singapore IDEC Izumi Asia Pte. Ltd.
Thailand IDEC Asia (Thailand) Co., Ltd.
India IDEC Controls India Private Ltd.

China IDEC (Shanghai) Corporation
IDEC Izumi (H.K.) Co., Ltd.
Taiwan IDEC Taiwan Corporation

 www.idec.com

Japan IDEC Corporation

Specifications and other descriptions in this brochure are subject to change without notice.

2021 IDEC Corporation, All Rights Reserved.

